


Westside Urban Renewal Plan, Core Area Revitalization & City Water System

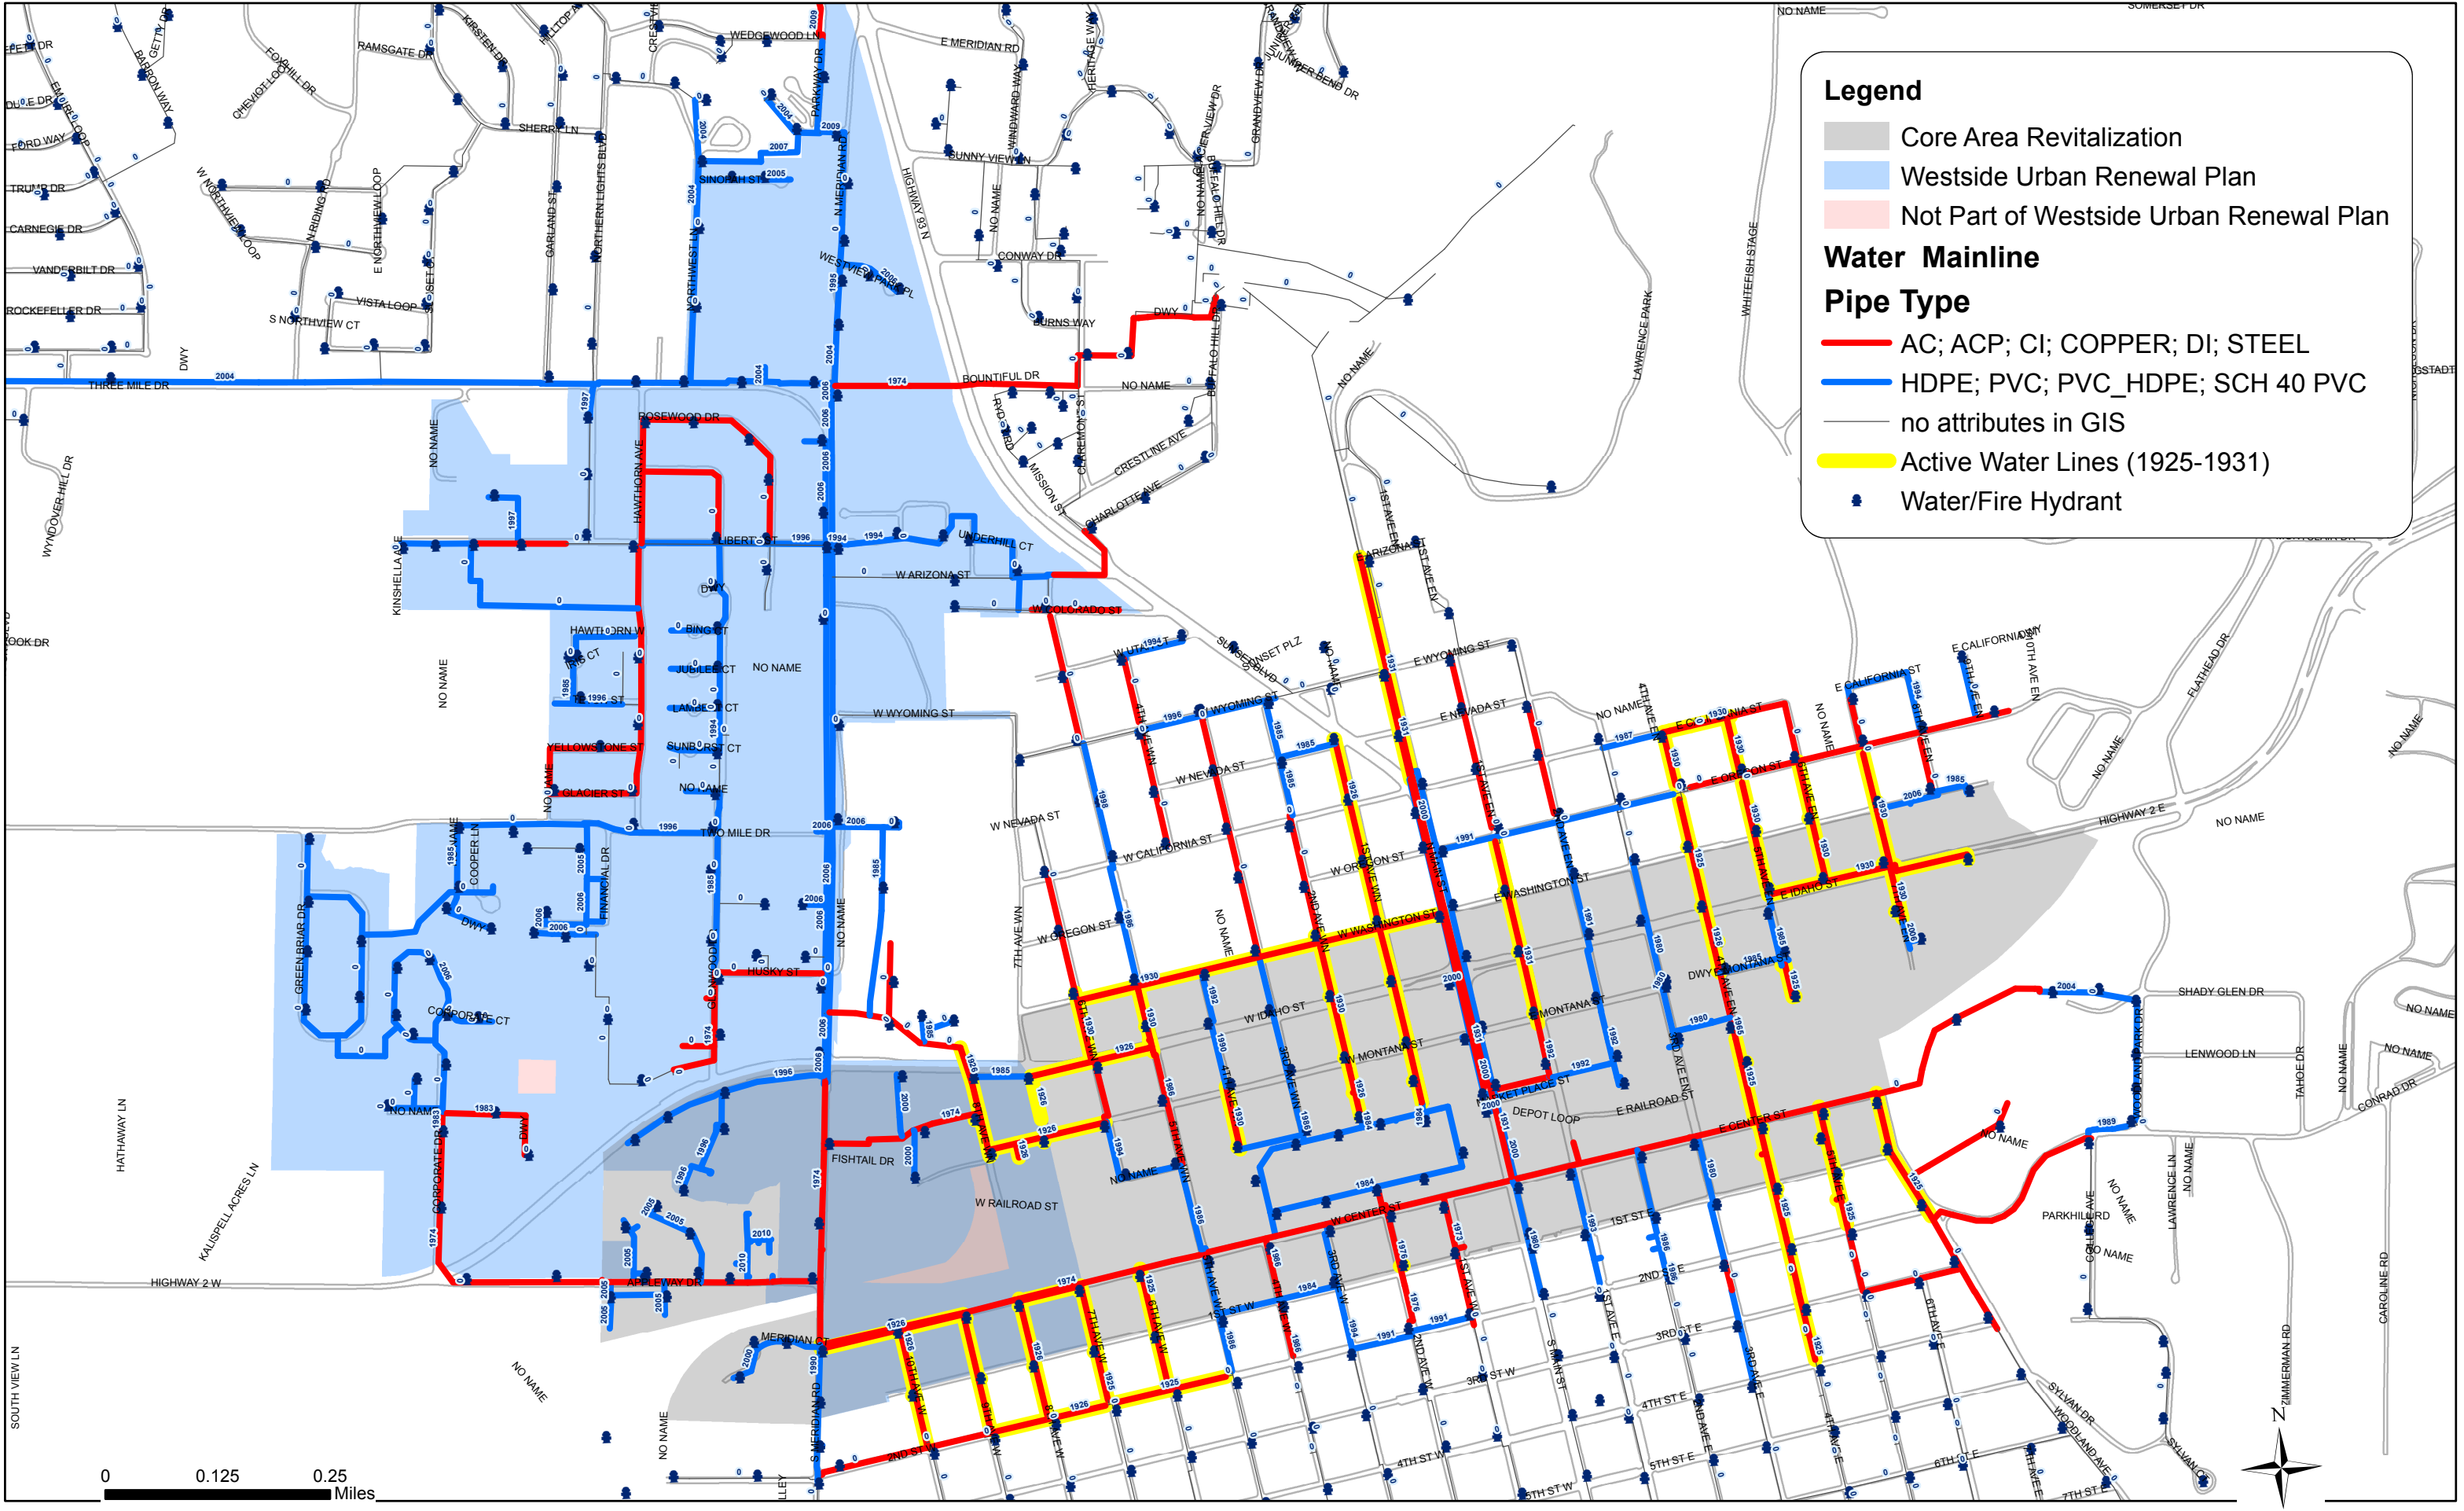

Legend

- Core Area Revitalization
- Westside Urban Renewal Plan
- Not Part of Westside Urban Renewal Plan

Water Mainline

Pipe Type

- AC; ACP; CI; COPPER; DI; STEEL
- HDPE; PVC; PVC_HDPE; SCH 40 PVC
- no attributes in GIS
- Active Water Lines (1925-1931)
- Water/Fire Hydrant

0 0.125 0.25 Miles

